
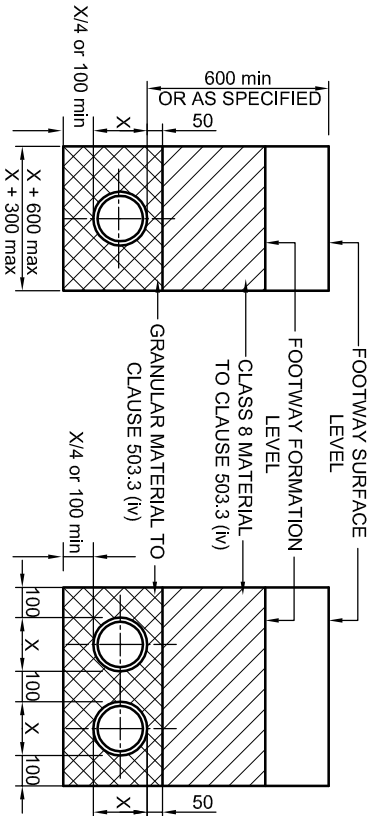


TYPICAL TRENCH DETAIL DUCTS IN CARRIAGEWAYS

NOTE
THE DUCT AND ITS CONCRETE SURROUND SHALL EXTEND BEHIND THE KERB
FACE BY A DISTANCE OF 0.5m OR INTO A MANHOLE WHERE INDICATED.

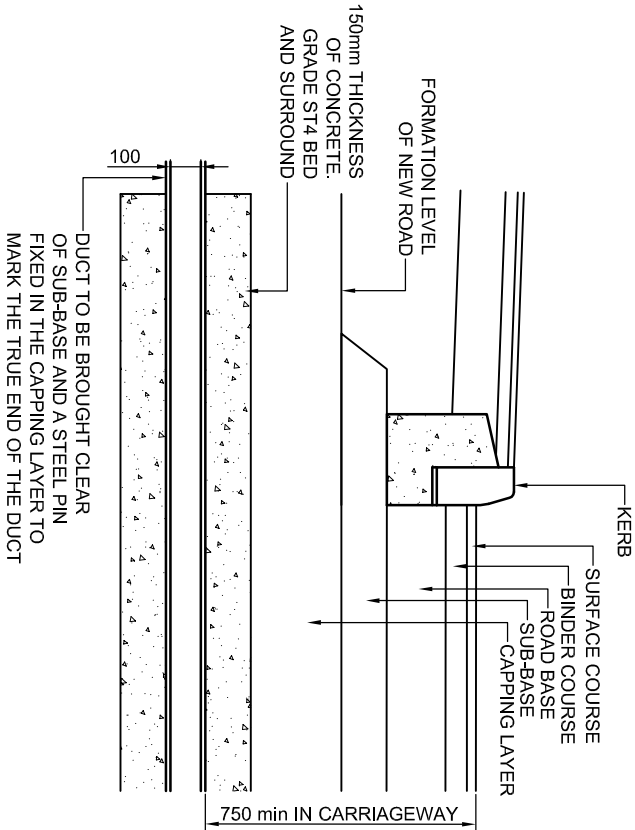

TYPICAL TRENCH DETAIL DUCTS IN FOOTWAYS

NOTES

1. ALL DIMENSIONS ARE IN MILLIMETRES.
2. DIMENSION 'X' IS THE EXTERNAL DIAMETER OF THE DUCT.
3. VITRIFIED CLAY AND U.P.V.C DUCTS SHALL INCORPORATE POLYPROPYLENE COUPLING.
4. NUMBER OF DUCTS TO BE ONE UNLESS STATED OTHERWISE.
5. ALL DUCTS TO BE 100mm.
6. EACH DUCT POSITION TO BE INDICATED ON KERB FACE WITH CHISELLED 'X'.
7. ROT PROOF DRAW CORDS TO BE PROVIDED THROUGH ALL DUCTS AND SECURED AT ALL ENDS.
8. DIMENSIONS OF DUCT AND LOCATIONS TO BE TAKEN FROM CONVENIENT AND SALENT POINTS E.G. GULLIES, AND SHOWN ON "AS CONSTRUCTED" DRAWINGS.
9. ANY BACKFILL NECESSARY BENEATH THE CAPPING LAYER SHALL BE ST1 MIX CONCRETE IN LAYERS NOT EXCEEDING 150mm.
10. FULL PAVEMENT DETAILS ARE GIVEN ELSEWHERE.

FRAMEWORK CONTRACT FOR HIGHWAY WORKS - MINOR WORKS CONTRACT

Walsall Council

Wolverhampton City Council

Dudley Metropolitan Borough Council

Sandwell Metropolitan Borough Council

Regeneration and Transportation

Drawing Title:		Drawing Number	
STANDARD DETAIL		SD/500/15	
SERVICE DUCT AND PROTECTION DETAILS		01	
DRAWN	SJC	DATE	JUL/09
CHECKED	JBF	SCALE	NTS
		Rev	